


1 - Three Line Drawing

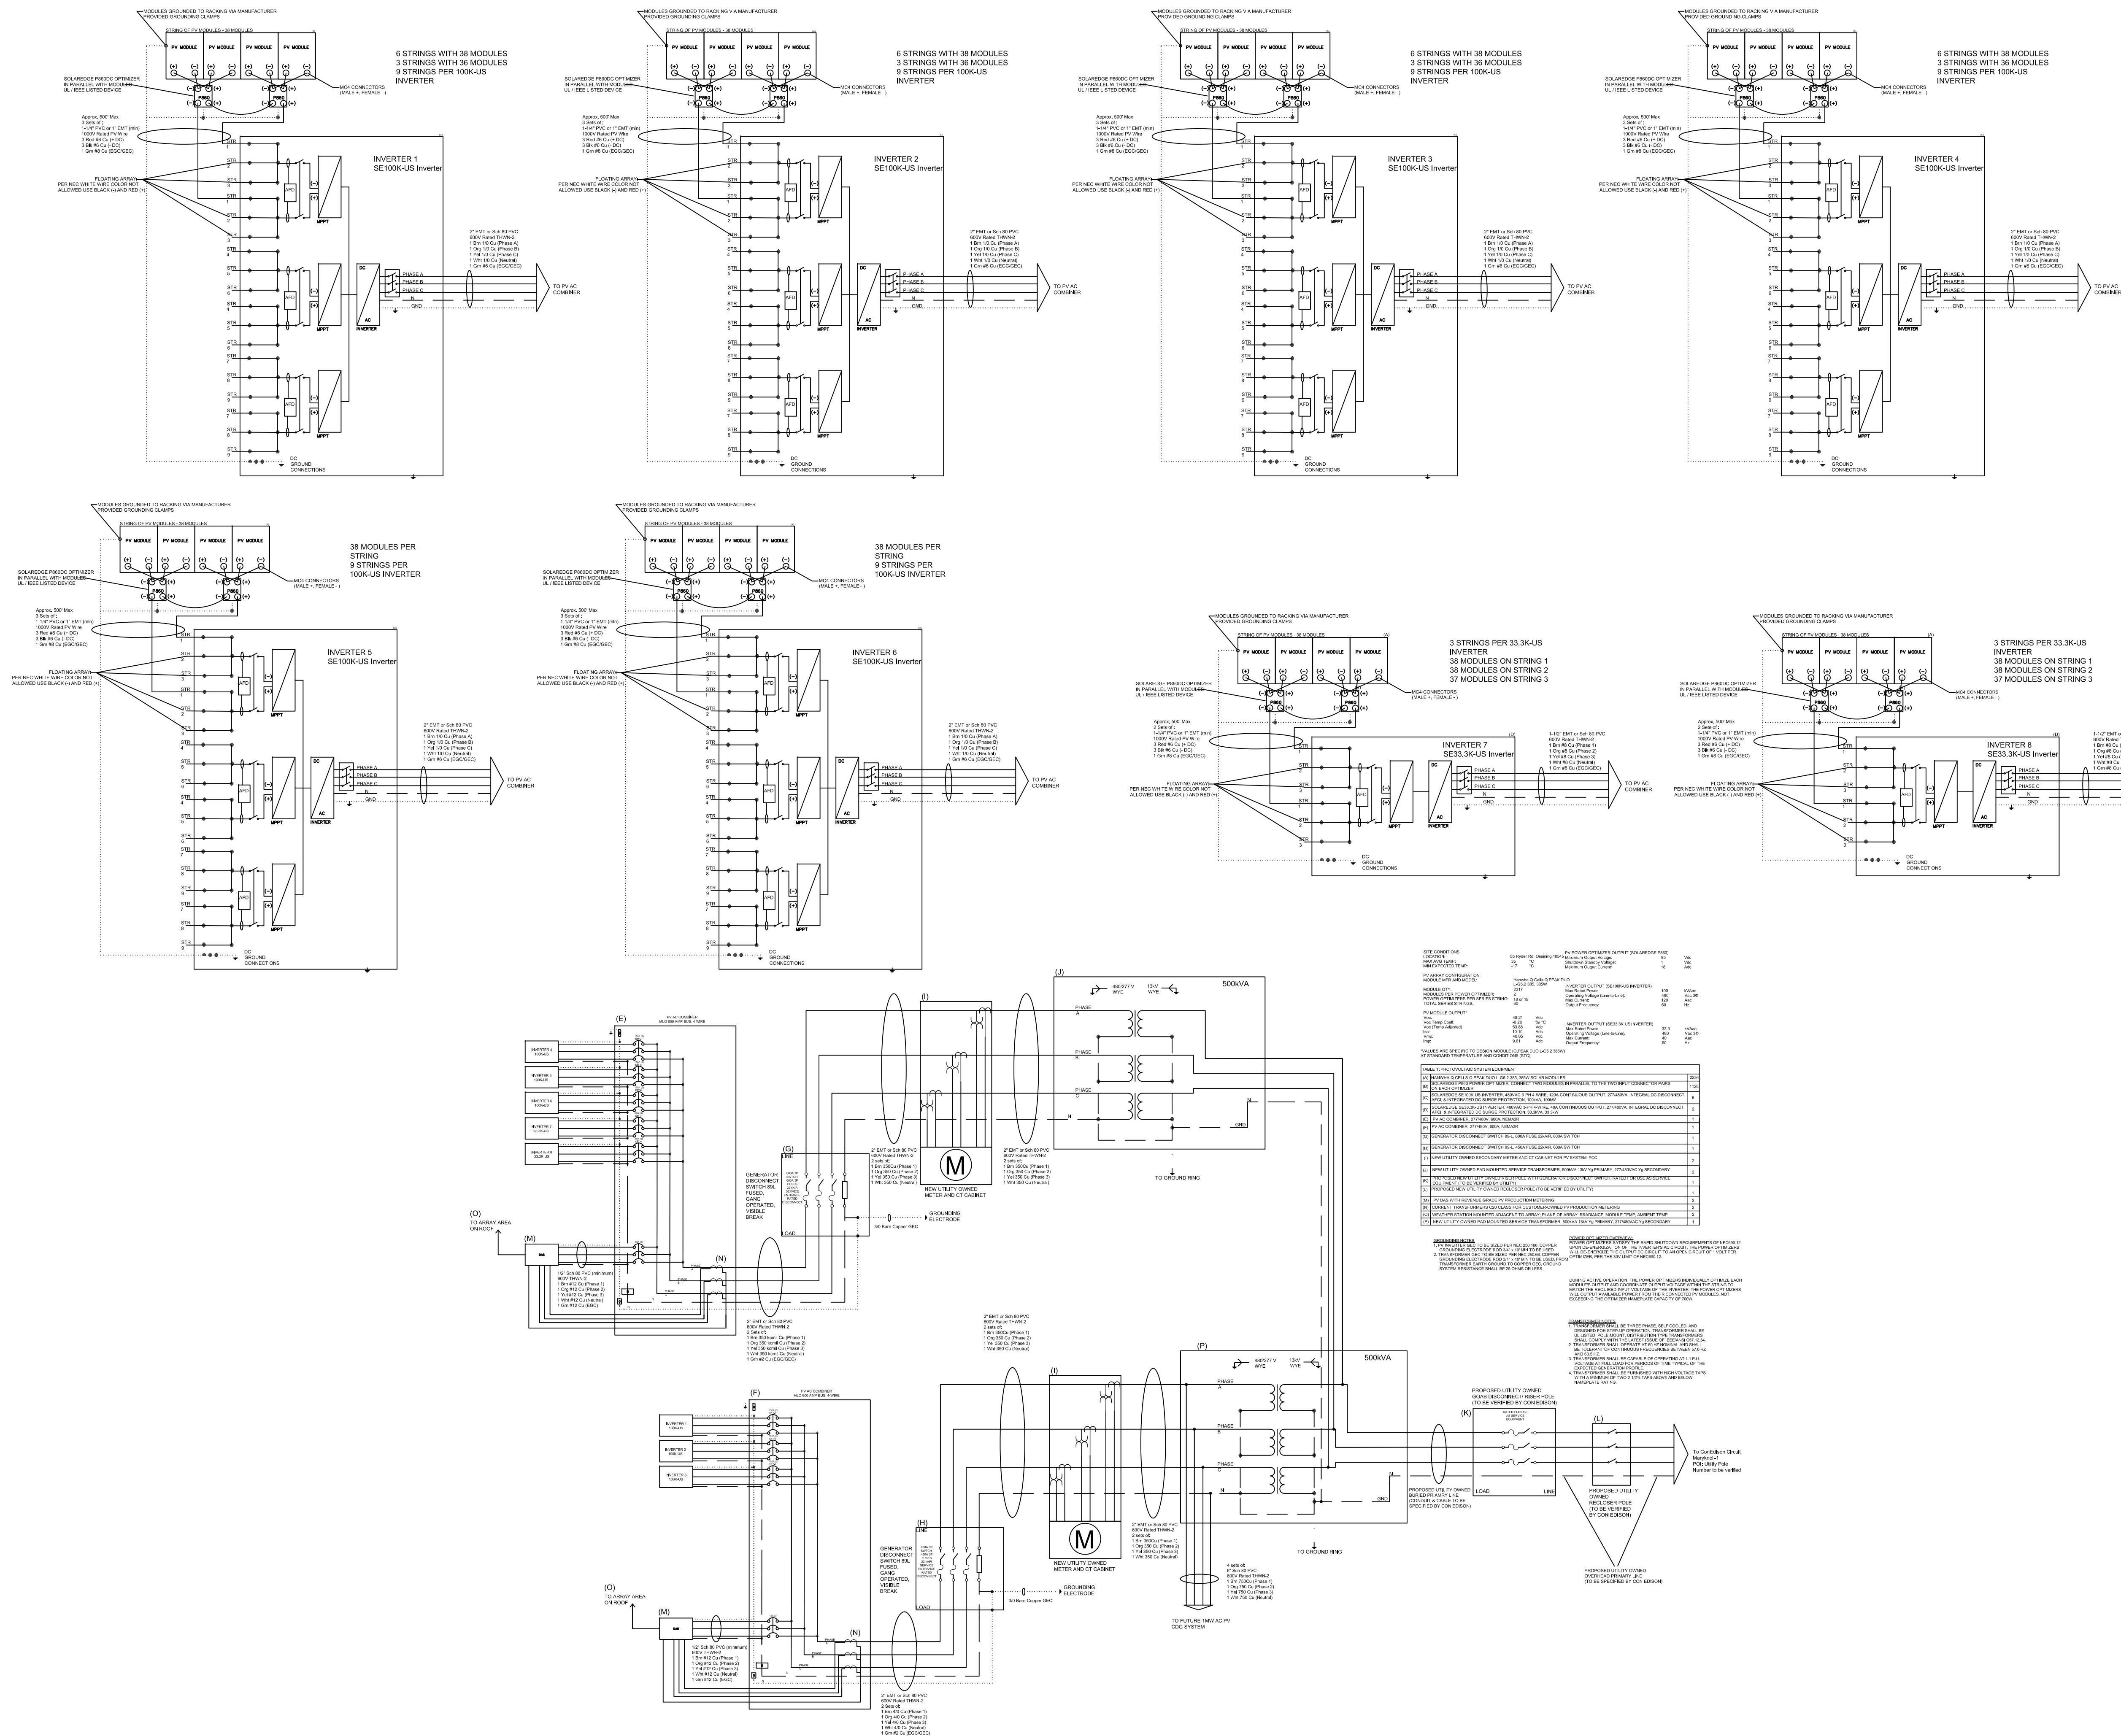

Ecogy Energy
67 West St, Suite 232,
Brooklyn, NY 11222
E: development@ecogysolar.com
P: 718-304-0945

Ecogy New York II LLC

**Preliminary Three Line
Drawing
Not for Construction**

Project Site:
Maryknoll
75 Ryder Road, Ossining
NY 10545
Account Number:TBD
New Service Case #:MC-434527

Project Description:

- 2254 Hanwha Q.PEAK DUO L-G5.2 385W Modules
- 1128 SolarEdge P860 Optimizers
- 6 SE100K-US Inverters
- 2 SE33.3K-US Inverters

867.79kW DC, 666.6kW AC.

This Drawing is not intended for construction and is subject to change pending utility approval.

THIS DRAWING IS FOR INFORMATION PURPOSES ONLY. CERTIFICATION OR VALIDATION IS TO BE DONE BY A PROFESSIONAL WITH EXPERTISE IN THE REQUIRED FIELD AND A LICENSE IN THE STATE THAT THE INSTALLATION WILL RESIDE. CERTIFICATION OR VALIDATION TO BE INCLUDED AS PART OF THE SUBMITTALS FOR PERMITTING OF THE OVERALL PROJECT.

Professional Stamp

Codes & Standards:

- NEC 2014
- IBC 2015 with NY Amendments
- ConEdison DG Interconnection & Service Requirements
- Local AHJ - Ossining
- Installing contractor and all personnel onsite shall follow appropriate LOTO procedures before servicing equipment and shall be equipped with the appropriate PPE
- Contractors shall notify Dig Safe prior to construction

Sheet 1 of 1 (ARCH D)

Date	Drafter	Revision
7/26/2019	PV	A
8/9/2019	PV	B
8/20/2019	PV	C
9/30/2019	LZ	D
4/21/2020	JL	E